



Most Widely Accepted and Trusted

ESR-1331

Reissued 11/2018
Revised 02/2019

ICC-ES Evaluation Report

ICC-ES | (800) 423-6587 | (562) 699-0543 | www.icc-es.org

This report is subject to renewal 11/2019.

DIVISION: 06 00 00—WOOD, PLASTICS AND COMPOSITES
SECTION: 06 05 23—WOOD, PLASTIC, AND COMPOSITE FASTENINGS

REPORT HOLDER:

MAINE DECK BRACKET CO.

EVALUATION SUBJECT:

MAINE DECK BRACKET



“2014 Recipient of Prestigious Western States Seismic Policy Council (WSSPC) Award in Excellence”



ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.



ICC-ES Evaluation Report

ESR-1331

Reissued November 2018

Revised February 2019

This report is subject to renewal November 2019.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 06 00 00—WOOD, PLASTICS AND COMPOSITES
Section: 06 05 23—Wood, Plastic, and Composite Fastenings

REPORT HOLDER:

MAINE DECK BRACKET CO.

EVALUATION SUBJECT:

MAINE DECK BRACKET

1.0 EVALUATION SCOPE

Compliance with the following codes:

- 2018, 2015, 2012, 2009 and 2006 *International Building Code*® (IBC)
- 2018, 2015, 2012, 2009 and 2006 *International Residential Code*® (IRC)

Property evaluated:

Structural

2.0 USES

The Maine Deck Bracket is used to attach an exterior deck or balcony ledger to a solid sawn lumber rim board of an existing or new structure.

3.0 DESCRIPTION

The bracket is manufactured from ¹/₄-inch-thick (6.4 mm) aluminum alloy Grade 6061-T6, complying with ASTM B221. The bracket is H-shaped and predrilled with four ⁹/₁₆-inch-diameter (14.3 mm) holes on each flange-face. See Figures 1 and 2 for illustrations of the bracket.

4.0 DESIGN AND INSTALLATION

4.1 General:

Installation of the Maine Deck Bracket shall comply with this report and the manufacturer's published installation instructions. The manufacturer's published installation instructions shall be available at the jobsite at all times during installation.

4.2 Design:

The bracket shall be bolted to the wood framing member (rim board) and to the wood deck header or ledger. Allowable design loads indicated in this report are limited to the use of ¹/₂-inch-diameter (12.7 mm) hex head bolts and 1-inch-diameter (25.4 mm) washers. The bolts and washers shall be hot-dipped, zinc-coated galvanized steel complying with the requirements of ASTM A307

Grade A or SAE Grade 2 (see Footnote 1 of Table 1). See Table 1 for the maximum allowable design loads per bracket.

Design information provided to the code official shall include the following:

- Number, location and spacing of brackets.
- Maximum design loads anticipated at each bracket, in accordance with the applicable code.
- Allowable loads of the brackets, as specified in this report.
- Size, grade, type, quantity and corrosion protection covering of the bolts used to secure the brackets to the deck and building framing members, consistent with this report.
- Species, grade, size, and specific gravity of the wood members to which the bracket is attached.

4.3 Installation:

Refer to the manufacturer's published installation instructions for installation details. For installation on an existing structure, an area of the exterior wall covering equivalent to the area of the bracket face shall be removed from the framing at the attachment location. Weather protection shall be installed in accordance with IBC Section 1403.2 or IRC Section R703.1.

5.0 CONDITIONS OF USE

The Maine Deck Bracket described in this report complies with, or is a suitable alternative to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1** Installation shall comply with this report, the manufacturer's published installation instructions and the applicable code. In the event of a conflict between the manufacturer's published installation instructions and this report, this report shall govern.
- 5.2** Allowable loads in Table 1 are based on brackets attached to nominally 2-inch-thick-by-6-inch-wide No. 2 southern pine or Douglas fir-larch solid sawn lumber with a specific gravity of 0.50 or greater.
- 5.3** Design loads determined in accordance with the applicable code shall not exceed the allowable loads for the Maine Deck Bracket as set forth in Table 1.
- 5.4** The maximum on-center spacing of the Maine Deck Bracket shall be 8 feet (2428 mm).
- 5.5** Design calculations and details in accordance with Section 4.2 shall be submitted to the code official at

the time of permit application. The calculations shall be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.

- 5.6 The design and construction of the deck supported by the deck bracket and the supporting construction of the deck bracket, including framing members and foundations, are outside the scope of this report and shall comply with the applicable code.
- 5.7 The compatibility of the bracket with preservative-pressure-treated or fire-retardant-treated wood is outside the scope of this report.
- 5.8 Rim joists shall be constructed with continuous fastening and support in accordance with Table 2304.10.1 for the 2018 and 2015 IBC (Table 2304.9.1 for the 2012, 2009, and 2006 IBC), or Table R602.3(1) of the IRC. Details to resist the effects of torsion in the rim joist shall be submitted to the code official.

6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Joist Hangers and Similar Devices (AC13), dated October 2018.

7.0 IDENTIFICATION

- 7.1 The Maine Deck Bracket described in this report shall be identified with the manufacturer’s name (Maine Deck Bracket) and/or trademark, the product name and the evaluation report number (ESR-1331).
- 7.2 The report holder’s contact information is the following:

MAINE DECK BRACKET CO.
176 GRANGE AVENUE
MINOT, MAINE 04258
(207) 345-8501
www.deckbracket.com
bracket@megalink.net

TABLE 1—MAXIMUM ALLOWABLE DESIGN CAPACITIES PER BRACKET^{1,2,3,4}

RIM BOARD AND LEDGER THICKNESS (inches)	VERTICAL DOWNLOAD CAPACITY (PARALLEL TO WEB FACE) (lbf)	LATERAL CAPACITY (PERPENDICULAR TO WEB FACE) (lbf)
1½	1000	1115
3	1160	1115


For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.4N, 1 in-lbf = 0.112 N-m.

¹Allowable capacities are based on four ½-inch-diameter-by-4½-inch-long hex head bolts through the rim board and four ½-inch-diameter-by-3-inch-long hex head bolts through the deck/balcony header complying with ASTM A307 Grade A or SAE Grade 2, with 1-inch-diameter washers on all wood surfaces. If longer length bolts are required, calculations shall be submitted to the code official to verify compliance with the allowable design loads shown above.

²Capacities shall be multiplied by the applicable wet service factor for dowel-type fasteners in accordance with the *National Design Specification® for Wood Construction* (NDS).

³Capacities are based on deck joist spacing not exceeding 24 inches (610 mm) on center.

⁴Capacities are limited to No. 2 Southern pine or Douglas fir–larch solid sawn lumber with a specific gravity of 0.50 or greater.

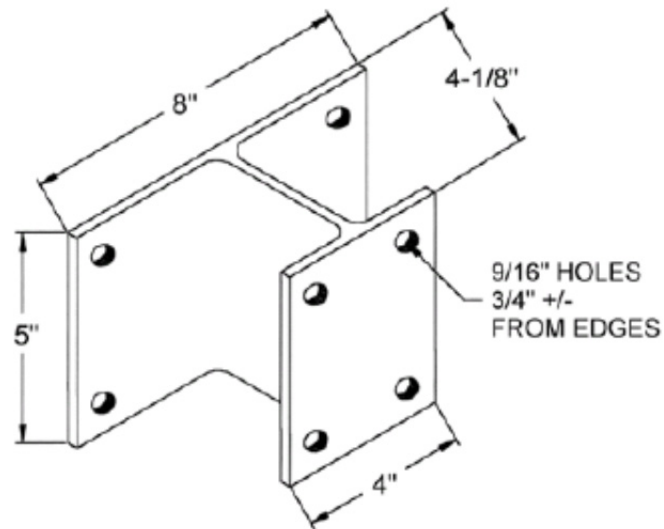

For SI: 1 inch = 25.4 mm.

FIGURE 1—BRACKET DETAIL

- A - RIM BOARD
- B - SHEATHING
- C - SIDING
- D - LARGE BRACKET FLANGE ATTACHED TO HOUSE
- E - BRACKET WEB
- F - DECK LEDGER
- G - BOLTS

Note: Water-resistive barrier and flashing are not shown for clarity.

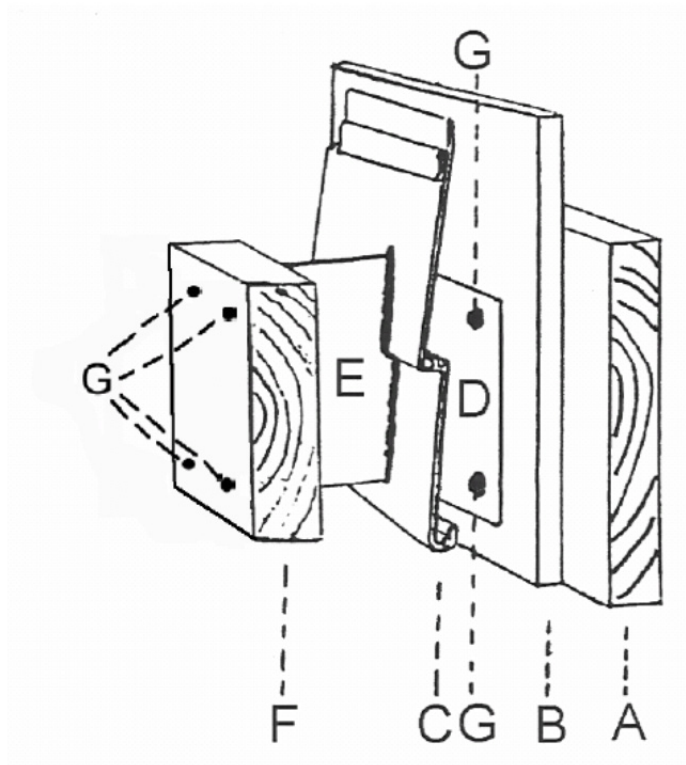


FIGURE 2—INSTALLATION DETAIL